




DISCOVERY[®]

INTELLIGENT FIRE DETECTORS

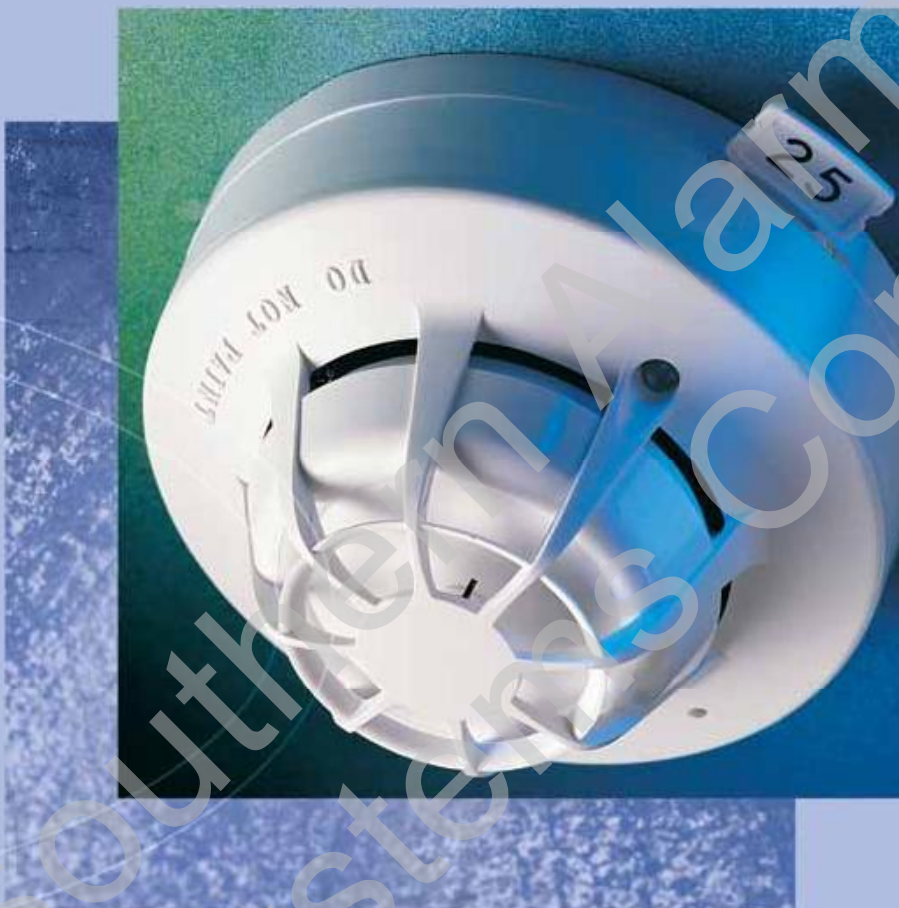

- 5 Response modes
- Drift compensation
- User programmable
- Rejection of transient signals

DISCOVERY®

INTELLIGENT FIRE DETECTORS

Discovery is a range of high-specification, intelligent fire detectors developed to meet the requirements of sophisticated systems while providing engineers with an additional dimension in fire protection capability. Discovery gives you total reassurance in installations where adaptability to changing conditions and protection against unwanted alarms are paramount.



Optical Smoke Detector

The Discovery optical smoke detector is suitable for slow burning or smouldering fires and should be positioned where these are most likely to occur. They can be set to a sensitivity mode best suited for the application.

Part No. 58000-600



Ionisation Smoke Detector

Ionisation detectors use a low activity radioactive foil to detect fires by irradiating the air in the smoke chambers and causing a current flow. If smoke enters the chamber, the current flow is reduced leading to an alarm. It is a good general purpose detector that responds well to fast burning, flaming fires.

Part No. 58000-500



Heat Detector

The Discovery heat detector, distinguishable by the low airflow resistant case, uses a single thermistor to sense the air temperature around the detector. This type of detector is particularly useful where the environment is dirty or smoky under normal conditions.

Part No. 58000-400

Multisensor Detector

The Discovery multisensor detector comprises optical smoke and thermistor temperature sensors whose outputs are combined to give the final analogue value. As a result, the multisensor is useful over a wide range of applications and is highly immune to false alarms.

Part No. 58000-700



Carbon Monoxide (CO) Detector

The Discovery CO fire detector is good at detecting deep-seated fires. See the chart below for information on typical applications. *Please note CO detectors do not detect smoke particles or heat and are not universal replacements for smoke detectors.* Please refer to Apollo publication PP2089.

Part No. 58000-300



Manual Call Point

The Discovery manual call point can be addressed at the commissioning stage by means of a seven-segment DIL switch. When operated, the MCP interrupts the polling cycle for a fast response.

Part No. 58100-910



Control Panel Compatibility

Discovery detectors are designed to be operated with purpose-designed control and indicating equipment that makes full use of their features. Discovery can be connected to any control panel which can operate XP95® systems but the Discovery features can then not be accessed. For a list of compatible panel manufacturers, see Apollo publication PP1010.

Compatible Products

A full range of interfaces, sounders, beacons, sounder beacons, flame and beam detectors designed for use with intelligent systems is available from Apollo. For details please ask for brochures or visit our website.

Drift Compensation

All Discovery smoke detectors include compensation for sensor drift caused, for example, by dust in the chamber, and will hold the sensitivity at a constant level even with severe chamber contamination.

Sensitivity Selection

Each detector in the Discovery range can operate in one of five response modes, which can be selected from the control panel. The response characteristics of the detectors have been carefully set so that the detectors will comply with the requirements of the relevant part of EN54 in all response modes. Mode selection depends on application – Mode 1 will give a higher sensitivity to fire than Mode 5. See table below for more information.

XPERT Card and Base

The XPERT card is a unique, patented addressing method whereby the address is set by simply removing the 'pips' on the card according to a chart supplied with the base. The coded card is then inserted into the side of the base where it locks into position. The XPERT card simplifies and speeds up the installation and commissioning.



Discovery Response Mode Selection Grid.

	Cleanroom EDP suite					Hotel room; Studio apartment; Small flat (<50m²)					Office; Long corridor; Hospital ward; Light industrial factory					Warehouse; Bar					Loading bay; Car park					Kitchen; Laundry (enclosed & ventilated)					Boiler room				
Mode	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5
MULTI	■						■						■				■							■					■						■
OPTICAL		■						■						■						■					■					■					■
ION																																			
CO																																			
HEAT																																			

KEY: ■ Recommended ■ Suitable ■ Suitable as supplement

For full technical details please see Engineering Product Guide PP2052.
For details of marine approvals PP2194.

© Apollo Fire Detectors Ltd 2003-2009

A HALMA COMPANY



36 Brookside Road, Havant,
Hampshire, PO9 1JR, UK.

Tel: +44 (0)23 9249 2412
Fax: +44 (0)23 9249 2754

Email: sales@apollo-fire.co.uk
Web: www.apollo-fire.co.uk

